




## EB 3ph



### FAAC

Via Benini, 1  
40069 Zola Predosa (BO) - ITALIA  
Tel. 0039.051.61724 - Fax. 0039.051.758518  
www.faacgroup.com

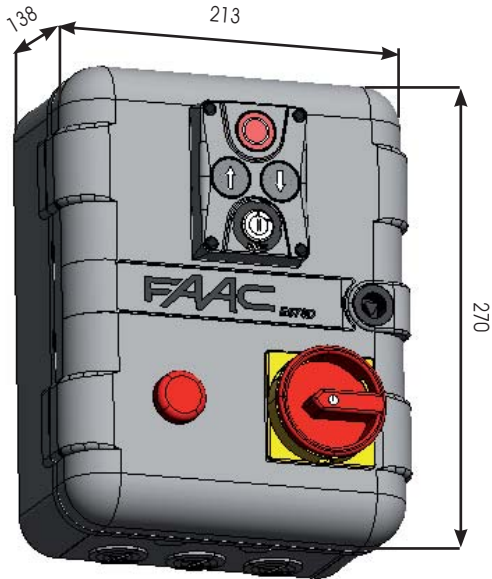

- GB -	EB 3ph
Operating voltage V ~ (+6%- 10%)	400 V (3ph+N)
Protection class	IP 54
Operating temperature	-20/+55 °C
Installation	Wall


- F -	EB 3ph
Tension V ~ (+6%- 10%)	400 V (3ph+N)
Degrè protection	IP 54
Température ambiante	-20/+55 °C
Installation	Au mur

- D -	EB 3ph
V ~ (+6%- 10%)	400 V (3ph+N)
Zchutzart	IP 54
Umgebungstemperatur	-20/+55 °C
Installation	Wand


- E -	EB 3ph
Tension de utilización V ~ (+6%- 10%)	400 V (3ph+N)
Grado de protección	IP 54
Temperatura ambiente	-20/+55 °C
Instalación	En pared

- I -	EB 3ph
Tensione di utilizzo V ~ (+6%- 10%)	400 V (3ph+N)
Grado di protezione	IP 54
Temperatura ambiente	-20/+55 °C
Installazione	A parete

- NL -	EB 3ph
Voedings spanning V ~ (+6%- 10%)	400 V (3ph+N)
Beschermingsgraad	IP 54
Temperatuur bedrijfs	-20/+55 °C
Installatie	Wand

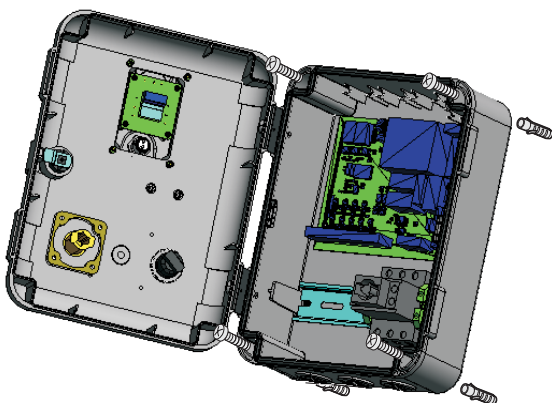

PG 21

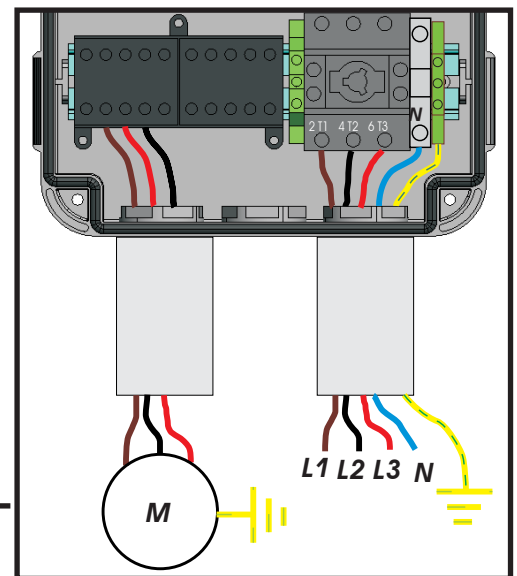

**EB 578 3PH**



- MODIFICARE SULLA SCHEDA E578D I SEGUENTI PARAMETRI:
- MODIFY THE FOLLOWING PARAMETERS ON 578D CONTROL BOARD:
- MODIFER LES PARAMÈTRES SUIVANTS DANS LA PLATINE E578D:
- VERÄNDERN SIE FOLGENDEN PARAMETER ÜBER DIE PLATINE E578D:
- MODIFICAR LOS PARÁMETROS SIGUIENTES EN E578D:
- OP DE STURINGSPRINT E578D DE VOLGENDE PARAMETERS WIJZIGEN:

LO = bC    rP = 00  
br = 00    rA = 00



- \* L'effetto sull'automazione della pressione dei tasti, varia in funzione della logica selezionata sulla centralina elettronica.
- \* When the keys are pressed, the effect on the automated system varies according to the logic that was selected on the control unit.
- \* L'effet de la pression des touches sur l'automatisme varie suivant la logique sélectionnée sur la centrale électronique.
- \* Wenn die Tasten gedrückt werden, ändert sich die Wirkung auf die Automation je nach der Logik, die auf der elektronischen Steuereinheit angewählt wurde.
- \* El efecto de la presión de las teclas en el automatismo cambia en función de la lógica seleccionada en la centralita electrónica.
- \* Het effect dat de druk van de toetsen op het automatische systeem heeft, verschilt afhankelijk van de op de elektronische besturingseenheid ingestelde logica.

